

DIGITALES ARCHIV

ZBW – Leibniz-Informationszentrum Wirtschaft
ZBW – Leibniz Information Centre for Economics

Souhe, Felix Ghislain Yem; Mbey, Camille Franklin; Boum, Alexandre Teplaira et al.

Article

Forecasting of electrical energy consumption of households in a smart grid

Provided in Cooperation with:

International Journal of Energy Economics and Policy (IJEPP)

Reference: Souhe, Felix Ghislain Yem/Mbey, Camille Franklin et. al. (2021). Forecasting of electrical energy consumption of households in a smart grid. In: International Journal of Energy Economics and Policy 11 (6), S. 221 - 233.

<https://www.econjournals.com/index.php/ijeep/article/download/11761/6121>.

doi:10.32479/ijeep.11761.

This Version is available at:

<http://hdl.handle.net/11159/7883>

Kontakt/Contact

ZBW – Leibniz-Informationszentrum Wirtschaft/Leibniz Information Centre for Economics

Düsternbrooker Weg 120

24105 Kiel (Germany)

E-Mail: [rights\[at\]zbw.eu](mailto:rights[at]zbw.eu)

<https://www.zbw.eu/econis-archiv/>

Standard-Nutzungsbedingungen:

Dieses Dokument darf zu eigenen wissenschaftlichen Zwecken und zum Privatgebrauch gespeichert und kopiert werden. Sie dürfen dieses Dokument nicht für öffentliche oder kommerzielle Zwecke vervielfältigen, öffentlich ausstellen, aufführen, vertreiben oder anderweitig nutzen. Sofern für das Dokument eine Open-Content-Lizenz verwendet wurde, so gelten abweichend von diesen Nutzungsbedingungen die in der Lizenz gewährten Nutzungsrechte.

<https://zbw.eu/econis-archiv/termsfuse>

Terms of use:

This document may be saved and copied for your personal and scholarly purposes. You are not to copy it for public or commercial purposes, to exhibit the document in public, to perform, distribute or otherwise use the document in public. If the document is made available under a Creative Commons Licence you may exercise further usage rights as specified in the licence.



Forecasting of Electrical Energy Consumption of Households in a Smart Grid

Felix Ghislain Yem Souhe^{1*}, Camille Franklin Mbey¹, Alexandre Teplaira Boum¹, Pierre Ele²

¹Department of Electrical Engineering, University of Douala-ENSET, 1872-Douala, Douala, Cameroon, ²Department of Electrical Engineering, University of Yaounde 1, Polytechnic, Yaounde, Cameroon. *Email: felixsouhe@gmail.com

Received: 24 June 2021

Accepted: 13 September 2021

DOI: <https://doi.org/10.32479/ijeep.11761>

ABSTRACT

This paper aims to develop a hybrid model for forecasting electrical energy consumption of households based on a Particle Swarm Optimization (PSO) algorithm associated with the Grey and Adaptive Neuro-Fuzzy Inference System (ANFIS). This paper proposes a new Grey-ANFIS-PSO model that is based on historical data from smart meters in order to estimate and improve the accuracy of forecasting electrical energy consumption. This accuracy will be characterized by coefficients such as Root Mean Square Error (RMSE), Mean Absolute Error (MAE) and Mean Absolute Percentage Error (MAPE). The PSO will allow to optimally design the Neuro-fuzzy forecasting. This method is implemented on Cameroon consumption data over the 24-years period in order to forecast energy consumption for the next years. Using this model, we were able to estimate that electricity consumption will be 1867 GWH in 2028 with 0.20158 RMSE and 0.62917% MAPE. The simulation results obtained show that implementation of this new optimized Neuro-fuzzy model on consumption data for a long period presents better results on prediction of electrical energy consumption compared to single artificial intelligence models of literature such as Support Vector Machine (SVM) and Artificial Neural Network (ANN).

Keywords: Forecast Model, PSO, ANFIS model, Grey Model, Electricity Consumption

JEL Classifications: C22, C25, C32, C41, C45

1. INTRODUCTION


Initially, power grids only included operations of production, transmission and distribution of energy, the capacities of which were not sufficient to ideally meet energy requirements. In recent years, these classical grid infrastructures have gradually undergone a transformation by a combination of digital systems referring to the notion of smart grid (Guerrero-Prado et al., 2020; Wang et al., 2018). The advent of the smart grid, considered to be the electricity grid of the future, comprising several new technologies, makes it possible to ensure better management of energy from generation sources to consumers, thus ensuring supply of energy demand. The main objective of a smart grid system is to optimize the operational functionalities through an integration of communication technologies and renewable resources to improve

reliability, efficiency and security of the electricity grid (Dileep, 2020; Foba Kakeu et al., 2021).

Figure 1 shows the architecture of a smart grid system.

This system consisting of an electrical network and communication network in which smart meters collect data and send it back through a wired or wireless communication network to the data center (Yip et al., 2017).

As a result, the new modernized and automated network is useful both for the consumer and the producer in the control and monitoring of energy consumption. Therefore, a balanced grouping consisting of smart meter, a two-way communication network and remote data management system, represents the

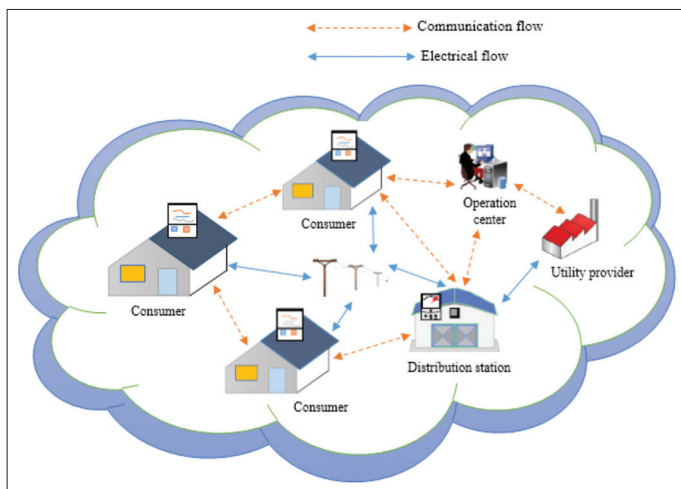Figure 1: Architecture of smart grid

Advanced Metering Infrastructure (AMI) whose role is crucial in energy distribution systems through recording and processing of load profiles and real-time consumption data thereby facilitating power flow distribution and information flow to ensure reliability and energy efficiency (Jiang et al., 2018). The advantages that the integration of smart meters brings into a network are diverse, in particular: the acquisition of energy management and used data, the management of its electricity consumption, safer billing, more reliable service, reduction of technical losses, reduction of energy theft, improvement of the security profile for consumers, and optimization in data management. The smart meters will therefore allow daily reading and collecting consumption data in real time. Analysing this data could be useful for utilities in understanding customer consumption behaviours (Bhattarai et al., 2019; Hurst and Curbelo Montañez, 2019). In addition, this data can also be transmitted to the data center for storage and automated processing (Völker et al., 2021). This opens up unprecedented possibilities for the analysis, storage, and combination of energy system data for the two entities which are the consumers and the operators of the electricity grid (Yem Souhe et al., 2021; Mbey et al., 2020).

Given the complexity of smart grid system, inefficient and inaccurate forecasting of electrical energy consumption could lead to load shedding, loss in production and consumption and possible grid collapse. So, it is necessary to make a forecast of energy demand in order to ensure a better transition to smart grid technologies (Wang et al., 2012). In the literature, several models have been proposed for forecasting electrical energy consumption. These models include: conventional models and artificial intelligence models.

Among the artificial intelligence models, Abdulsalam and Babatunde (2019) proposed a model for forecasting demand of electrical energy using a neural network for Lagos State in Nigeria. This model provides better results in terms of accuracy compared to other models. Wei et al. (2019) reviewed conventional models and artificial intelligence models. The conventional models are time series (TS) models, regression models and grid models. For Artificial Intelligence (AI) models, it introduced Artificial Neural Network (ANN) models, SVM models, and Random Forest (RF) models. Comert and Yildiz (2021) show a new model of Artificial

Neuronal Network for forecasting energy demand improving by temperature level and unemployment rate.

Zougagha et al. (2021) proposed hybrid artificial intelligence models for improving forecasting accuracy. This paper aims to study the artificial intelligence models used for forecasting. Kouhi and Keynia (2013) applied a cascade neural network model for the short-term prediction of the New York City energy system. Chae et al. (2016) also proposed a short-term forecasting model of building consumption based on artificial neural network model combined with a Bayesian regulation algorithm. Also, Mordjaoui et al. (2017) proposed a forecast of power consumption using a dynamic neuronal network. The performance of the model is verified by simulations on data collected from the network operator in France. In same time, Ahmad et al. (2014) reviewed various methods of predicting electrical energy in buildings using artificial intelligence methods such as SVM, neural networks. They shows that the hybridization of two forecasting techniques brings better results than with a single technique. The authors make comparisons showing that hybrid models provide better accuracy. In addition, Zhu et al. (2011) developed an improved hybrid model for electrical energy demand in China with an advantage over combined methods, hybrid models and optimization algorithms. This model is implemented on four power grids in China. The authors compared their models with the Seasonal Autoregressive Integrated Moving Average (SARIMA) model with the same time series. Other authors as Ardakani and Ardehali (2014) developed optimized regression and neural network models for forecasting electrical energy consumption based on several optimization methods. The authors presented a long-term forecasting going from 2010 to 2030, the data used in this study is made up of electrical energy consumption and socio-economic indicators. In their results it is proved that using historical data of socio-economic indicators brings more precision in energy consumption forecasting.

Other forecasting methods are presented by Aghay-Kaboli et al. (2017), in their paper they performed long-term formulation and prediction of electrical energy consumption through genetic-optimized programming. This genetic programming is applied to precisely formulate the relationship between historical data and electricity consumption. The authors compared their method with other methods such as the neural network, Support Vector Machine (SVM), Adaptive Neuro-Fuzzy Inference System (ANFIS), and cuckoo search algorithm. The Artificial Neural Network (ANN) approach was presented by Nasr et al. (2002) for energy consumption forecasting in Lebanon. Thus, four models of neural networks are presented and implemented on the real data of electrical energy consumption. Each of these models is characterized by error indexes such as Mean Square Error (MSE), mean percentage square errors (MPSE) and Mean Absolute Percentage Error (MAPE). Likewise, Zhang et al. (2020) explored forecasting of electrical load by recurrent support vector regression model with variational decomposition mode and the cuckoo search algorithm. This model has the advantage of being applicable to real data. Predicting electrical load by data mining techniques has also been studied by Abubaker et al. (2021) who proposed a combination of these data mining techniques such

as K-Means, K-Nearest Neighbours (KNN) and Autoregressive Integrated Moving Average (ARIMA). Other authors have also worked on conventional models for time series (Dritsaki et al., 2021; Sutthichaimethee and Wahab, 2021; Billah et al., 2021). Regarding the ARIMA, Vector Autoregressive (VAR) and Grey Models (GM), various works have been proposed with the aim of energy forecasting (Xu et al., 2015; Chaoqing et al., 2016; Feng et al., 2020; Yuan et al., 2016). Similarly, Guefano et al. (2020) worked on forecasting electricity consumption in the Cameroonian residential sector using Grey and vector autoregressive models. These authors have also projected on forecasting consumption using the multilinear regression model (Guefano et al., 2020).

Other hybrid models have been developed, Hafëez et al. (2020) proposed a fast and accurate machine learning model for predicting electrical energy consumption in a smart grid. This hybrid electrical power consumption forecasting algorithm proposed is being based on deep learning using linear rectified unit. This hybrid model is then tested and evaluated on data from the United States power grid on three performance factors: the average percentage deviation, the variance, the correlation coefficient and the convergence rate. Likewise, Li et al. (2018) presented a hybrid learning neural network for electrical energy consumption forecasting in buildings. This combined algorithm is made up of neural networks and applied for the hourly electrical prediction of two buildings in the United States and China. A hybrid random drill model combined with a multilayer perceptron is also proposed by Moon et al. (2018) for forecasting daily energy demand in a university campus. Also, Yang et al. (2021) proposed a hybrid model for time series forecasting. The final results show that the precision of this model is good compared to linear models. In this logic, Farsi et al. (2021) presented a short-term forecast of the electric charge using artificial intelligence techniques and a new deep parallel approach.

Optimized models are also used to improve accuracy in the analysis of consumption data. Kumaran and Ravi (2015) presented a hybrid model of artificial neural network and a biogeography-based optimization for long-term forecasting of electric power demand in India. This model considers socio-economic factors such as the population and uses two artificial neural networks which are trained by an optimization algorithm with the objective of making a perfect mapping of the input and output data in nonlinear space in order to obtain the best overall weight parameters.

In recent years, other optimized models have been developed resulting from a combination of several artificial intelligence models. Thus, Bahrami et al. (2014) proposed a short-term prediction of the electrical load by a wavelet transform and a Grey model improved by a PSO algorithm. In this optimized model, the input data considered are the average temperature, average humidity, average wind speed and data from the previous load. In this case, the wavelet transform is used to remove the high frequency component from the previous load data to improve the accuracy of the forecast. The effectiveness of the model is verified by implementing it on the forecast in New York and Iran. Kyung et al. (2005) predicted holiday energy consumption

using a linear fuzzy regression method. Recently, hybrid models have been used in particular by Kavousi-Fard et al. (2014) who proposed a forecasting algorithm composed of SVM and Firefly optimization algorithm. In addition to this, Selakov et al. (2014) proposed a new hybrid model for short-term demand forecasting based on particle swarm optimization and SVM. This model takes temperature into account in forecasting consumption. The model architecture consists of three modules including pre-processing module, PSO module and SVM module.

Recently, ANFIS model has spread in the scientific world for control systems, image processing and time series forecasting. For example, Mollaiy-Berneti (2016) developed an ANFIS model through a hybridization technique with Genetic Algorithm (GA) and applied it for the consumption forecast of the Iranian industrial sector. In this work, genetic algorithm ensures searching of optimal value guaranteeing a minimum number of rules and errors. A hybrid PSO-ANFIS approach for short-term forecasting of consumption in Portugal was made by Pousinho et al. (2011). Using the same PSO-ANFIS model and the GA-ANFIS model, Kasule (2020) show a forecast of electricity consumption in Uganda. In addition, other fairly efficient models have been developed in particular by Kazemi et al. (2014) who have developed a new short-term prediction based on a genetic algorithm for adaptive neuro-fuzzy inference system (ANFIS). Here, GA makes it possible to find the most suitable position of the inputs in order to build the model and subsequently this algorithm optimizes the weights of the rules.

Also, a combination of conventional statistical models and artificial intelligence models as ANFIS can be useful for forecasting energy consumption in the smart grid. Therefore, Shaikh et al. (2017) applied a method of forecasting power consumption using a linear fuzzy regression model. Shu and Luonan (2006) proposed a short-term load prediction model based on adaptive hybrid method. Barak and Sadegh (2016), authors implemented an ARIMA-ANFIS algorithm for forecasting energy consumption. This hybrid model improves the accuracy of single ARIMA and ANFIS models in forecasting energy consumption. Jadidi et al. (2019) presented a short-term forecast of energy demand using a Non-Dominated Sorting Genetic Algorithm II (NSGA II) and ANFIS model. NSGA II is used to select the input vector which is the input to the ANFIS model which will demonstrate the improved accuracy of the forecast. Through another similar model, Panapakidis and Dagoumas (2017) adopted a wavelet-ANFIS-GA-neural network transform for consumption forecasting. Another combined method by models SARIMA, neural network, ANFIS and Differential Evolution (DE) is proposed by Yang et al. (2016) in order to make a short term forecasting of electrical energy demand in South West Wales and Australia. Laouafi et al. (2015) developed three models for forecasting consumption using an ANFIS method of linear loads. Their results show the effectiveness of this combined approach of artificial intelligence models. Wang et al. (2012) improved the ARIMA model by incorporating a particle swarm optimization algorithm that reduces residual error.

As the results obtained from all these hybrid, combined or optimized models are not enough precise, other new methods must be implemented in order to improve the performance of the final

model. Thus, it would be necessary to develop a model that would consider a multitude of inherent parameters which can integrate the objective capacities of consumers and smart producers. In this paper, we have set up a Grey-ANFIS-PSO hybrid model. These three associated models provide better results compared to those in the literature. When the forecast is not precise, the optimization makes it possible to find the optimal point of the activation function.

This paper is structured as follows: section 2 presents the material and method, we present the dataset, Matlab software and the computer used. We also explain the operation of each model taken individually. Then, the proposed hybrid model combining the three methods is developed and implemented on the consumption data obtained from smart meters in Cameroon over 24 years period. Section 3 presents the simulation results and the forecast obtained from the training data and the validation data. These results show the unique capacity of the hybrid model proposed in this paper. Finally, a conclusion is given in section 4.

2. MATERIALS AND METHODS

2.1. Materials

2.1.1. Dataset

Several factors such as socioeconomic and demographic context, climatic and meteorological factor can affect the behaviour of electricity consumption. Smart meters make it possible to assess the consumption of each customer in the network, which will make it possible to forecast consumption in the future in order to adapt production to consumption. This electricity consumption depends on several variables such as socioeconomic variables, in particular the growth of the population, the number of consumers and suppliers, the type of consumers who can be residential, industrial, or commercial, the billing price of electricity consumption and the Gross Domestic Product (GDP) of the population. The data used in this paper was obtained from the Electricity Distribution Agency, the Cameroon Electricity Sector Regulatory Agency and the World Bank (<https://data.worldbank.org>).

Table 1 shows the evolution of the data between 1994 and 2017. In this table, it is observed data of consumers during 24 years from 1994 to 2017. For each year, there is value of GDP, population, subscribers and households.

2.1.2. Matlab

Matlab (Matrix Laboratory) is a software that was originally designed by Cleve Moler at the end of the 1970s, the company MathWorks ensures until today its continuous development. It is used for matrix and numeric calculations to analyze data. Matlab also allows programming for the intelligent resolution of complex problems. All our simulations were made using the Matlab R2020b 64 bit version.

2.1.3. Computer

All the simulations of this work were done on a computer with following characteristics: icore 5, 3.1 GHz processor, 8 GB RAM, Windows 10/64 bits.

2.2. Method

2.2.1. Grey model

Grey model was introduced by Deng Julong in 1982 for complex problems (Wang, 2009). Grey model has shown its effectiveness in the field of forecasting, in particular for forecasting of electricity consumption. In this paper, we use the Grey model of the form GM(1,1) whose procedure is described in four steps as follows:

(a) Initialization of the data series defined by equation (1):

$$X^{(0)} = \{x^{(0)}(1), x^{(0)}(2), \dots, x^{(0)}(n)\} \quad (1)$$

With:

$$i=1,2,\dots,n \text{ and } x^{(0)}(i) \geq 0$$

(b) Subsequently, the generated data series is given by equation (2):

$$X^{(1)} = \{x^{(1)}(1), x^{(1)}(2), \dots, x^{(1)}(n)\} \quad (2)$$

With:

$$x^{(1)}(t) = \sum_{i=1}^k x^{(0)}(i) \text{ and } k=1,2,\dots,n$$

(c) Knowing that $x^{(1)}(t)$ is defined by the first order differential equation:

$$\frac{dx^{(1)}(t)}{dt} + \alpha x^{(1)}(t) = \beta \quad (3)$$

With α and β the model development and control parameters.

(d) Using the least squares method and differential equations, we obtain equation (4) which describes the parameter \hat{a} :

$$\hat{a} = \begin{bmatrix} \alpha \\ \beta \end{bmatrix} = (B^T B)^{-1} B^T Y \quad (4)$$

With B and y_n the matrices of the form system.

$$D = \begin{bmatrix} -0.5(x^{(1)}(1) + x^{(1)}(2)) & 1 \\ -0.5(x^{(1)}(2) + 0.5x^{(1)}(3)) & 1 \\ \vdots & \vdots \\ -0.5(x^{(1)}(n-1) + x^{(1)}(n)) & 1 \end{bmatrix} \quad \text{and } Y = \begin{bmatrix} x^{(0)}(2) \\ x^{(0)}(3) \\ \vdots \\ x^{(0)}(n) \end{bmatrix}$$

2.2.2. PSO algorithm

PSO is a meta-heuristic technique introduced by Kennedy and Eberhart in 1995. It is based on behavior of birds and insects. In the PSO, the population is called a swarm and is made up of individuals called particles. The PSO algorithm is initialized with a number of iterations and particles. The moving of each particle consists in converging towards the region having the best potentials having optimal solutions. Each particle has a memory function and gradually adjusts its path based on its own experiences and the experience of other particles. The path taken by each particle is based on the best particular position p_{best} and the best global

Table 1: Dataset

Years	GDP in Billion (USD)	GDP per capita (USD)	Population	Number of subscribers*1000	Number of Households*1000
1994	10600,1577	801,2	13230984	381	2384
1995	9643,95317	709,1	13599988	401	2451
1996	10513,3874	752,5	13970813	420	2521
1997	10833,4975	755,2	14344449	427	2593
1998	10612,8474	720,8	14723768	447	2667
1999	11198,3787	741	15112592	451	2743
2000	10083,9377	650	15513945	451	2819
2001	10371,3278	651,1	15928910	452	2897
2002	11579,3431	707,9	16357602	488	2977
2003	14548,8458	866	16800865	504	3059
2004	17430,9335	1009,9	17259322	507	3144
2005	17944,0842	1011,9	17733410	527	3286
2006	19356,0463	1062,1	18223674	537	3367
2007	22365,265	1194,1	18730282	571	3468
2008	26409,7812	1371,7	19252666	614	3548
2009	26017,9256	1314,7	19789919	660	4081
2010	26143,8185	1285,3	20341241	711	4188
2011	26337,0068	1403,3	20906388	707	4210
2012	29104,4374	1354,6	21485266	709	4252
2013	32348,1499	1465,2	22077298	852	4294
2014	34942,9487	1540,6	22681858	887	4337
2015	30916,2185	1327	23298368	927	4533
2016	32621,5354	1363,4	23926539	969	4733
2017	34922,7823	1421,6	24566045	1012	4942

position g_{best} of the swarm. Each particle has two vectors, in particular the position vector X_i and the velocity vector V_i . Each iteration of the PSO consists of moving the particle through space in order to find the optimal solution. The velocity vector and the position vector can be expressed by equations (5) and (6):

$$V_i^{t+1} = wV_i^t + c_1r_1(pbest - X_i^t) + c_2r_2(gbest - X_i^t) \quad (5)$$

$$X_i^{t+1} = X_i^t + V_i^{t+1} \quad (6)$$

With:

V_i^{t+1} : speed of the particle to the next position

V_i^t : speed of the particle on the previous position

p_{best} : best particular position

g_{best} : best global position

X_i^t : previous position of the particle

X_i^{t+1} : next particle position

c_1 and c_2 : positive acceleration constants to maintain the balance between individual and social behavior

r_1 and r_2 : are the numbers generated in a loop in the interval 0 and 1.


w : weight of inertia to maintain the balance between exploration and exploitation.

Figure 2 shows the flowchart of the PSO algorithm.

2.2.3. ANFIS model

ANFIS (Neuro-Fuzzy Adaptive Inference System) is a combination of neural networks and fuzzy systems. This neuro-fuzzy system was introduced in 1993 based on the “if-then” condition to build the space from input to output for the appropriate functions. The fuzzy rules also make it possible to define various inherent

Figure 2: PSO algorithm flowchart

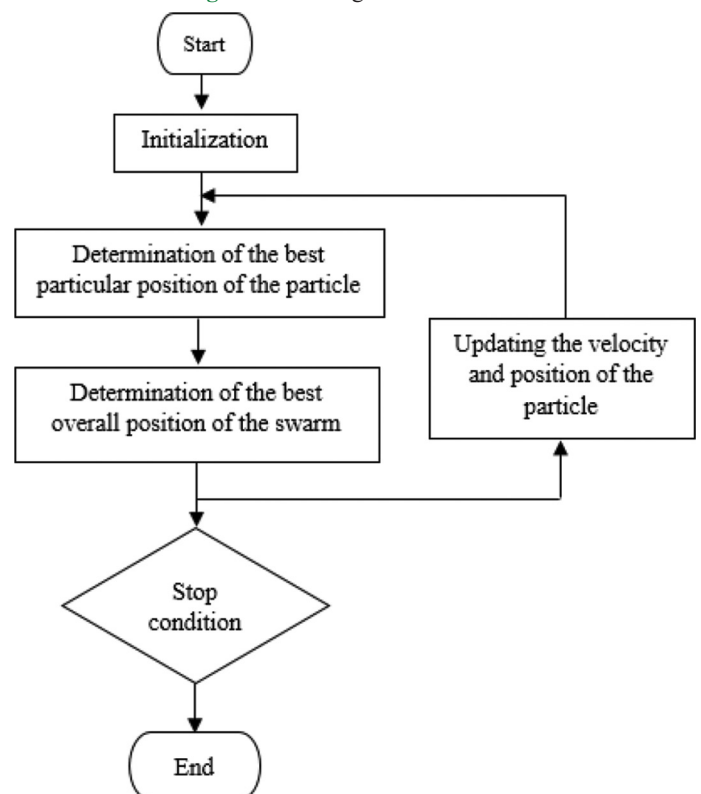

relationships between the parameters of ANFIS. Each fuzzy rule ensures behavior description. The fuzzy system element is used to define functions of a member of inference system. The neural network element provides for the continuous and automatic extraction of the built-in rules from the fuzzy system based on the digital data in order to adapt the parameters of the limb functions through the learning process.

In Sugeno’s ANFIS model, a fuzzy rule is represented by:

If x_1 is b_1 and x_2 is b_2 and x_3 is b_3 and x_4 is b_4 then $y = f(x_1, x_2, x_3, x_4)$

With:

x_1, x_2, x_3 and x_4 : fuzzy parameters from previous inputs.

y : output function which in our case represents the power consumption.

Inputs and output are considered member functions. These member functions and fuzzy rules provide the optimization parameters through the learning process.

In our paper we implement the ANFIS method in order to partition the data to reduce the complexity and the number of fuzzy parameters to optimize.

Figure 3 gives the structure of the ANFIS model.

2.2.4. Hybrid approach proposed Grey - ANFIS - PSO

Figure 4 shows the flowchart of forecasting electrical energy consumption using the Grey - ANFIS - PSO model. The ANFIS framework generates a single output from the Sugeno inference system and improves system parameters using input/output training data. The training algorithm uses a combination of the least squares gradient and back propagation methods to model the training database.

The proposed model is a combination of the Grey model, the PSO algorithm and the Adaptive Neuro-Fuzzy Inference System (ANFIS). Grey model makes it possible to generate the forecast with a limited amount of consumption data. This model is very useful when you do not have complete training data. The PSO makes it possible to update the parameters of the model by searching for the optimum parameters for an accurate forecasting. ANFIS model or Sugeno-type neuro-fuzzy inference system allows forecasting to be made based on training data and testing on validation data. The parameters of the proposed model are optimized by the PSO algorithm. They are determined by trial

and error simulations. The RMSE and MAPE parameters are used to verify the accuracy of the model. If the accuracy is not suitable, the PSO algorithm can change the parameters of the model and start the optimization procedure. These parameters can be changed consecutively. This model is applied to the electricity consumption data of Cameroon in order to generate the electricity consumption forecasting data. Using this model allows to obtain an accurate graphical representation of forecasting electrical energy consumption.

The accuracy of model is evaluated using equations (7), (8), (9) and (10):

$$MSE = \frac{1}{N} \sum_{i=1}^N (y_i^* - y_i)^2 \tag{7}$$

$$MAE = \frac{1}{N} \sum_{i=1}^N |y_i^* - y_i| \tag{8}$$

$$MAPE = \frac{1}{N} \sum_{i=1}^N \left| \frac{y_i^* - y_i}{y_i} \right| \times 100\% \tag{9}$$

$$RMSE = \sqrt{\frac{1}{N} \sum_{i=1}^N (y_i^* - y_i)^2} \tag{10}$$

With:

N: size of data

y_i : actual test value

y_i^* : forecasting value

MAPE: Mean Absolute Percentage Error

MSE: Mean Square Error

RMSE: Root Mean Square Error

MAE: Mean Absolute Error

MAPE acceptability criteria are defined in Table 2.

3. RESULTS AND DISCUSSION

Consumption data for 24 years (1994-2017) for Cameroon are recorded by meters and are available at the level of the distribution

Figure 3: Structure of the ANFIS model

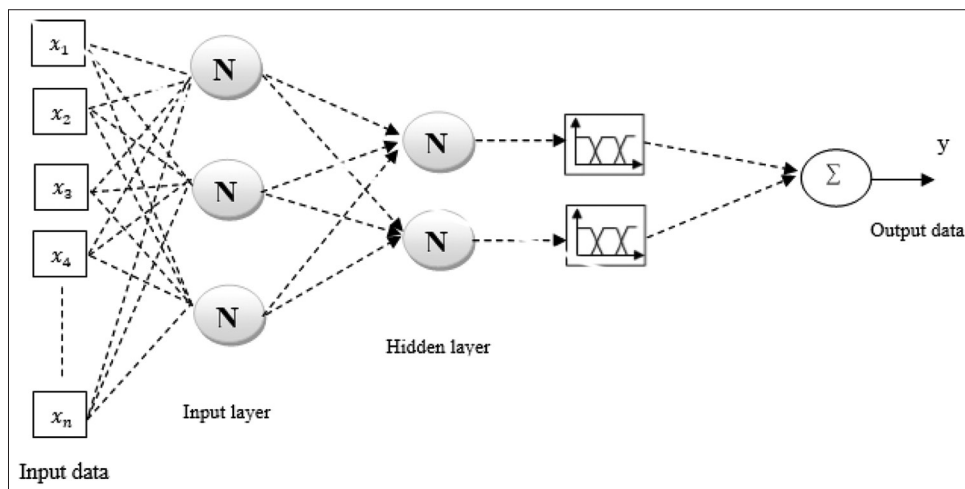


Figure 4: Flowchart of the proposed method

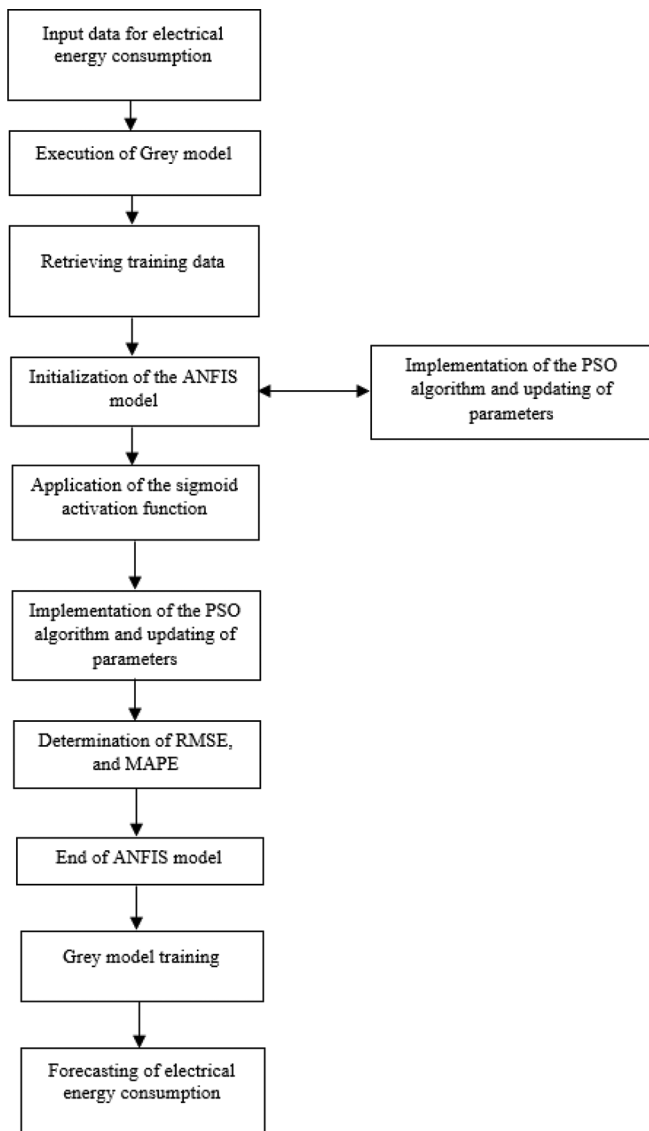


Table 2: MAPE acceptability criteria

MAPE (%)	Forecasting accuracy
<10	Excellent forecasting
10-20	Good forecasting
20-50	Reasonable forecasting
>50	Bad forecasting

company. Figure 5 shows the evolution of this consumption during these years.

These data are available online from the Electricity Distribution Agency for the verification and validation of the model.

Considering input data including socio-economic parameters and data from smart meters in particular, we propose an ANFIS model as shown in Figure 6 We can first train the ANFIS model.

For this model, each fuzzy rule considers the number of consumers, the GDP per customer and the number of households to provide power consumption output. The epoch number was set to 1000, for each iteration we get the values of RMSE, MAPE, MAE and

Figure 5: Consumption data for 24 past years


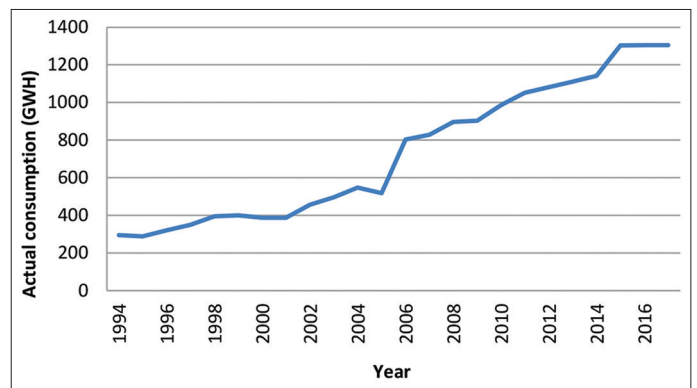


Figure 6: ANFIS sugeno model

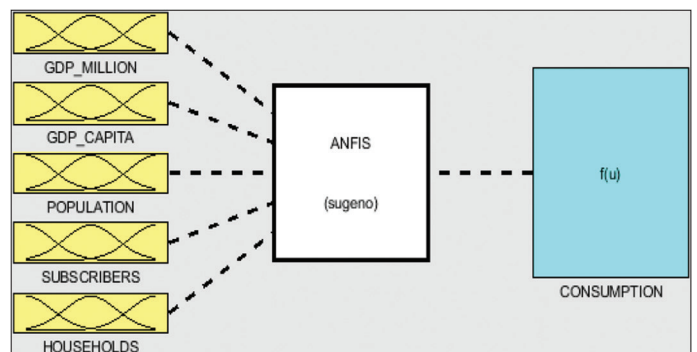

R. This paper aim to minimize these errors using optimization algorithms. Training data is 90% of input data, and test data is 10%. Figure 7 shows the training data and the output data of the fuzzy model on Matlab.

The validation of the model is carried out using test data. Figure 8 shows the test data and the data from the model.

Applying ANFIS model requires incorporating fuzzy rules that depend on the overall functioning of the model. Thus, the fuzzy rules of the ANFIS model are given by Figure 9. The number of fuzzy rules 243, which is related to the number of data of the input layer.

From the ANFIS model, it results error coefficients, in particular 1.2401 RMSE and 6.20% MAPE. The training procedure using the model training algorithm optimizes the parameters of the member function in order to build an adequate relationship between inputs and outputs. In this work, the PSO algorithm optimizes the input parameters of the member function as well as the correlation factors of the output of the ANFIS model. In the hybridization of ANFIS-PSO model, ANFIS is considered as an individual or a particle positioning itself as a possible solution to the optimization problem. The input data was randomly subdivided around the model's training base. Regarding the PSO, it considered in this paper, the size of the population being 120 particles for 1000 iterations knowing that the factors C1 and C2 are 1.5 and 1.2 respectively.

The ANFIS model optimized by the PSO is given in Figure 10.

Figure 11 shows the editor for the ANFIS-PSO model. We can observe a gradual decrease in the training error for the continuous evolution of the iteration.

We observe small reduction of errors, the RMSE is 0.32576 and the MAPE is 3.0817%.

The evolution of the training error of the ANFIS-PSO model shows the limit of this model in increasing the accuracy of the system in forecasting consumption. In order to optimize the input and output parameters and make a perpetual adjustment of the random values of the model following the gradient of the second-derivative

Figure 7: Training data of the ANFIS model

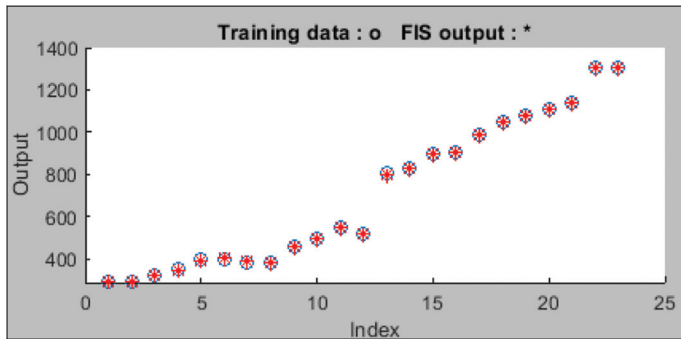


Figure 8: Test data of ANFIS model


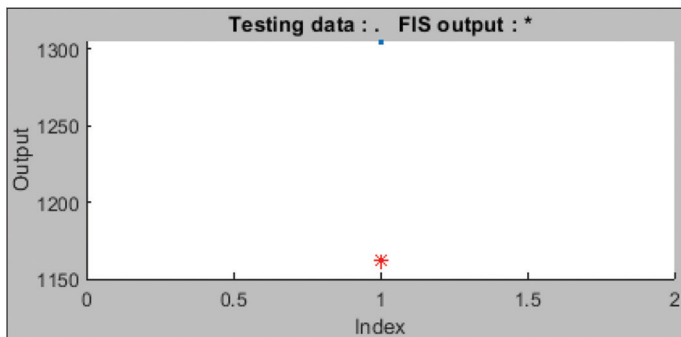


Figure 9: Fuzzy rules of the ANFIS model

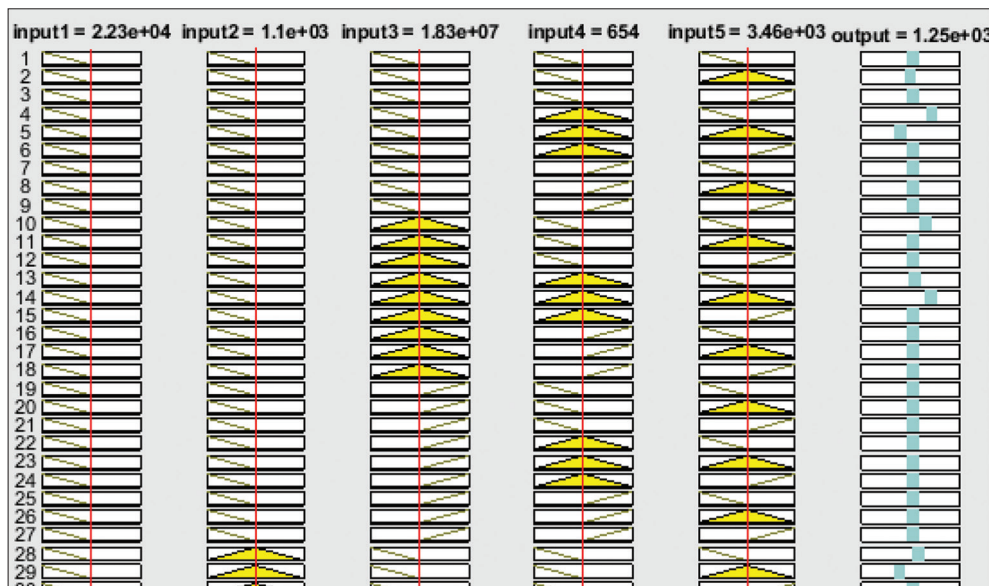

equation and considering the least squares method, we have also implemented the Grey method in the ANFIS model optimized by the PSO. Figure 12 shows the Grey-ANFIS-PSO model.

Configuring ANFIS-PSO editor by integrating the Grey method for the control value of the model, we obtain Figure 13 showing the training error for the global Grey-ANFIS-PSO model.

For this model, the RMSE and MAPE coefficients are respectively 0.20158 and 0.62917%.

In order to make a better representation of the accuracy of the model, the error indications and the correlations of the models are given in Figure 14.

As can be seen, the Grey-ANFIS-PSO model gives better correlation and low error coefficients as RMSE and MAPE. The actual consumption, and forecasting consumption results according to different models implemented in our paper for 24 years are presented in Figure 15.

It is noted that Grey-ANFIS-PSO model presents better results of forecast with a very weak error compared to the other models implemented in our method.

Figure 16 shows the predicted evolution using the Grey-ANFIS-PSO model. The demand for electric power is growing over the next 10 years. Consumption increases from 1305 GWH in 2017 to 1867 GWH in 2028.

A summary of the results of the forecast models from our paper is given in Table 3.

Table 3: Error coefficients of forecasting models

Model	RMSE	MAE	MAPE	R
ANFIS	1.2401	34.2644	6.20%	0.9860
ANFIS-PSO	0.32576	29.4241	3.0817%	0.9883
Grey-ANFIS-PSO	0.20158	22.0816	0.62917%	0.9969

Figure 10: ANFIS model optimized by the PSO

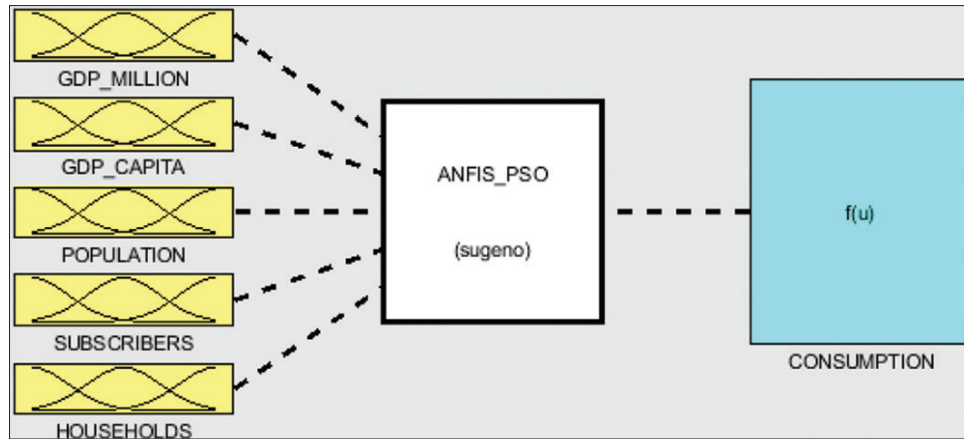


Figure 11: ANFIS-PSO model editor

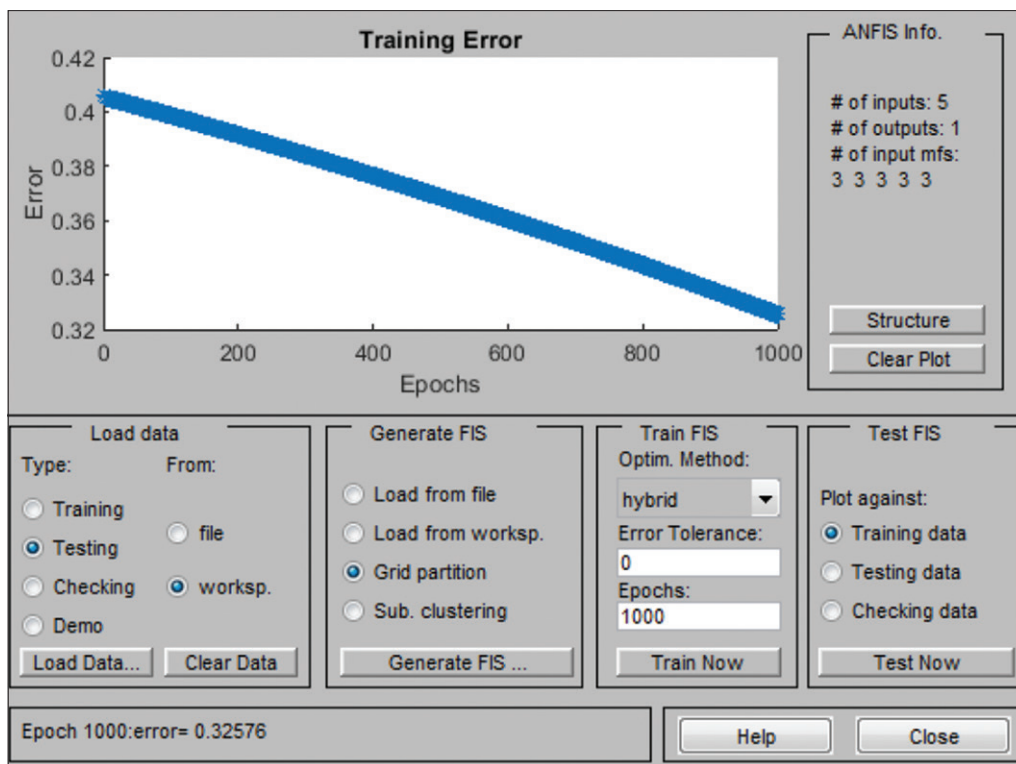


Figure 12: Grey-ANFIS-PSO model

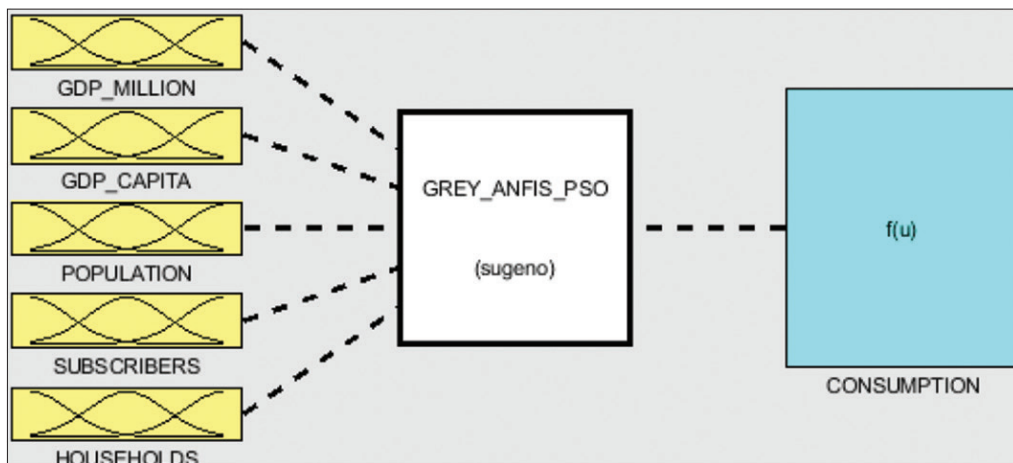


Figure 13: Grey-ANFIS-PSO model editor

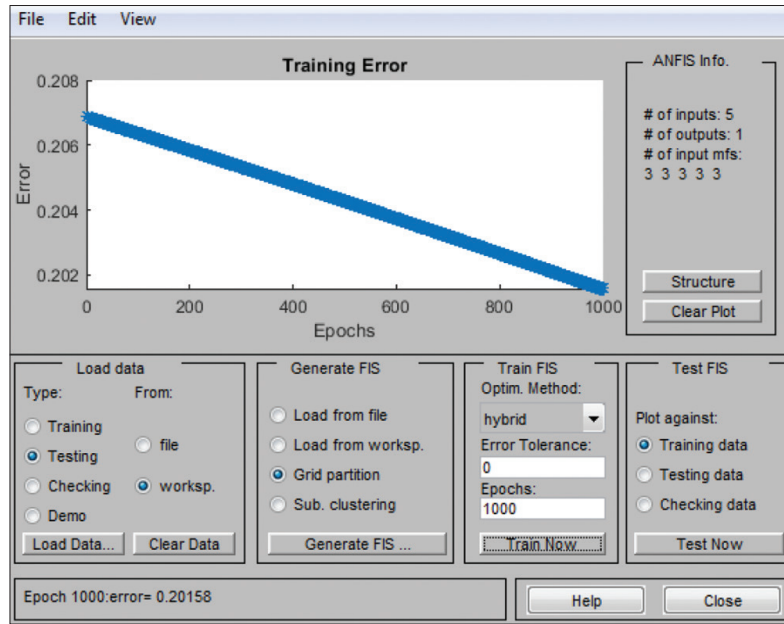


Figure 14: (a) Correlation of the ANFIS, (b) Correlation of ANFIS-PSO model, (c) correlation of Grey-ANFIS-PSO model


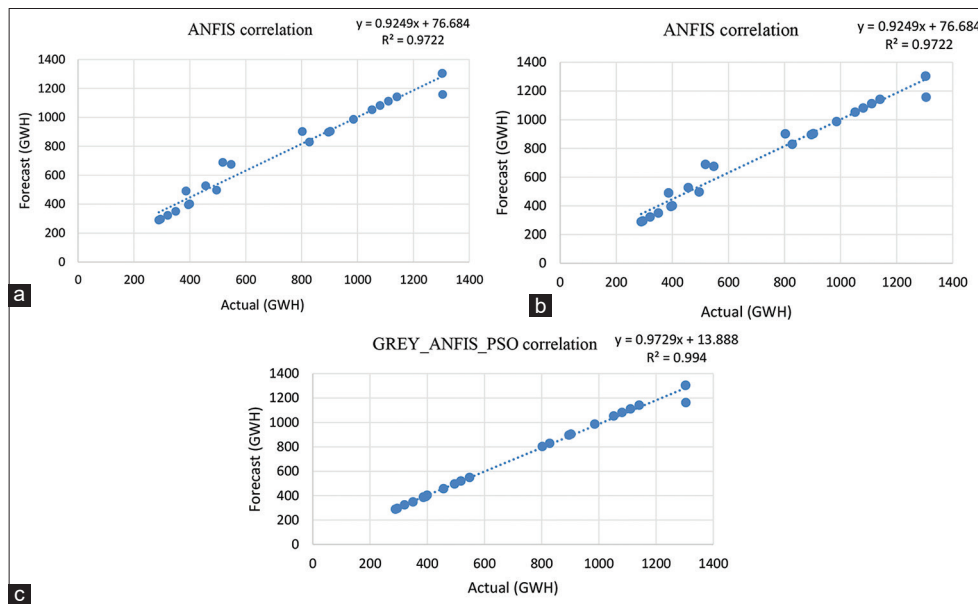



Figure 15: Results of forecasting models

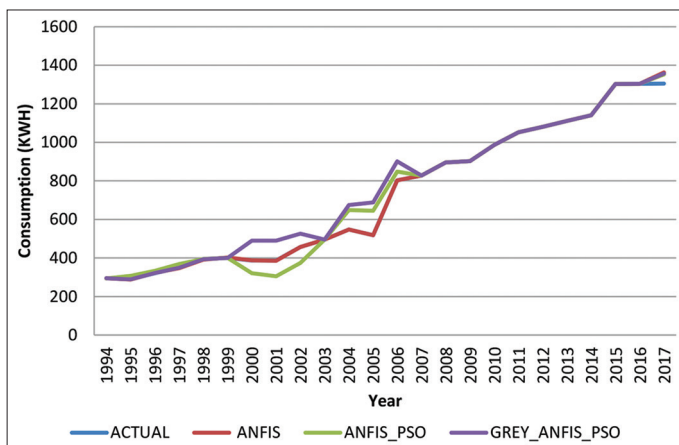

At the end, comparison tests were carried out to assess the efficiency of our hybrid model compared to hybrid models that already exist in the literature. The new model that is proposed in this paper satisfies the requirements and presents better results in terms of accuracy coefficients.

Table 4 is a comparative table with the models used in the literature.

It can be seen in Table 3 that our model presents better results in terms of precision. This model, which has never been made before, therefore shows an incredible precision never equaled. We conclude that our hybrid model therefore offers better precision and more reliable forecasting capabilities. Therefore these interesting results that we obtain are due to the fact that our hybrid model includes determining components which makes it

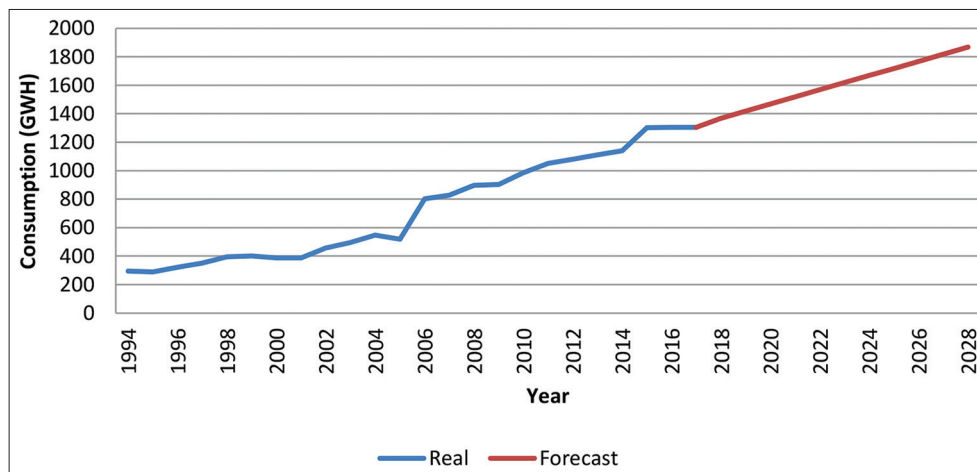Figure 16: Forecasting of consumption by the model Grey-ANFIS-PSO**Table 4: Comparison of the proposed model with the literature**

Model	RMSE	MAE	MAPE	R	Authors
GM (1,1)_ ARMA (2,1)	-	-	4.39%	-	Xu et al., 2015
GM (1,1)_ ARIMA (2,1,1)	-	-	2.30%	-	Chaoqing et al., 2016
VMD_ SVM_PSO	3648.830	-	-	-	Feng et al., 2020
VMD_SR_ SVRCBCS	85.5	-	0.9%	-	Zhang et al., 2020
GM (1,1)_ VAR (1)	15.42	-	1.629%	-	Guefano et al., 2020
GM (1,1)_ ANFIS_ PSO	0.20158	22.0816	0.62917%	0.9969	Writers

perfectly operational and allowing to characterize the evolution of the electricity consumption.

4. CONCLUSION

This work proposed a new optimized hybrid model based on the neuro-fuzzy inference system. In this paper, the input data considered consist of GDP in millions, GDP per capita, population, number of subscribers and number of households. The evolution of these parameters is considered between 1994 and 2017. The proposed algorithm can be used for estimating future electrical demand by optimizing the input parameters. The ANFIS model applied makes it possible to classify, train and validate data. The PSO algorithm ensures the optimization of the model parameters. The accuracy of these models is evaluated by errors such as RMSE, MAPE, MAE and R. The combination of ANFIS model and PSO algorithm makes it possible to obtain 0.32576 RMSE, 3.0817% MAPE, 29.4241 MAE and 0.9883 R. In order to improve these values as much as possible, we have also implemented the Grey model to obtain a hybrid model Grey-ANFIS-PSO. The new values of RMSE, MAPE, MAE and R are respectively 0.20158, 0.62917%, 22.0816 and 0.9969. These convincing and satisfactory results show the effectiveness of this new model for forecasting the consumption of electrical

energy. In addition, the precision values in this article are better than those in the literature.

5. ACKNOWLEDGMENTS

The authors would like to gratefully acknowledge the department of electrical engineering and the research team.

REFERENCES

- Abdulsalam, K.A., Babatunde, O.M. (2019), Electrical energy demand forecasting model using artificial neural network: A case study of Lagos State Nigeria. *International Journal of Data and Network Science*, 3, 305-322.
- Abubaker, M. (2021), Household electricity load forecasting toward demand response program using data mining techniques in a traditional power grid. *International Journal of Energy Economics and Policy*, 4, 132-148.
- Aghay-Kaboli, S. Hr., Fallahpour, A., Selvaraj, J., Rahim, N.A. (2017), Long-term electrical energy consumption formulating and forecasting via optimized gene expression programming. *Energy*, 126, 144-164.
- Ahmad, A.S., Hassan, M.Y., Abdullah, M.P., Rahman, H.A., Hussin, F., Abdullah, H., Saidur, R. (2014), A review on applications of ANN and SVM for building electrical energy consumption forecasting. *Renewable and Sustainable Energy Reviews*, 33, 102-109.
- Ardakani, F.J., Ardehali, M.M. (2014), Long-term electrical energy consumption forecasting for Developing and developed economies based on different optimized models and historical data types. *Energy*, 65, 452-461
- Bahrami, S., Hooshmand, R.A., Parastegari, M. (2014), Short term electric load forecasting by wavelet transform and grey model improved by PSO (particle swarm optimization) algorithm. *Energy Reviews*, 29, 1-10.
- Barak, S., Sadegh, S.S. (2016), Forecasting energy consumption using ensemble ARIMA-ANFIS hybrid Algorithm. *International Journal of Electrical Power and Energy Systems*, 82, 92-104.
- Bhattarai, B.P., Paudyal, S., Luo, Y., Mohanpurkar, M., Cheung, K., Tonkoski, R., Hovsopian, R., Myers, K.S., Zhang, R., Zhao, P., Manic, M., Zhang, S., Zhang, X. (2019), Big data analytics in smart grids: state-of-the art, challenges, opportunities, and future directions. *IET Smart Grid*, 2(2), 141-154.
- Billah, T.M.M., Mohd N.M.N., Ali, A., Baharum, F., Tahir, M.Z., Salameh, A.A.M. (2021), Forecasting impact of demand side

- management on Malaysia's power generation using system dynamic approach. *International Journal of Energy Economics and Policy*, 11(6), 412-418.
- Chae, Y.T., Horesh, R., Hwang, Y., Lee, Y.M. (2016), Artificial neural network model for forecasting sub-hourly electricity usage in commercial buildings. *Energy Build*, 111, 184-194.
- Chaoqing, Y., Sifeng, L., Zhigeng, F. (2016), Comparison of China primary energy consumption forecasting by using ARIMA (the autoregressive integrated moving average) model and GM(1,1) model. *Energy*, 100, 384-390.
- Comert, M., Yildiz, A. (2021), A novel artificial neural network model for forecasting electricity demand enhanced with population-weighted temperature mean and the unemployment rate. *Turkish Journal of Engineering*, 6(2), 178-189.
- Dileep, G. (2020), A survey on smart grid technologies and applications. *Renewable Energy*, 146, 2589-2625.
- Dritsaki, C., Niklis, D., Stamiatiou, P. (2021), Oil consumption forecasting using ARIMA models: An empirical study for Greece. *International Journal of Energy Economics and Policy*, 11(6), 214-224.
- Farsi, B., Amayri, M., Bouguila, N., Eicker, U. (2021), On short-term load forecasting using machine learning techniques and a novel parallel deep LSTM-CNN approach. *IEEE Access*, 9, 31191-31212.
- Feng, Z.K., Niu, W.J., Tang, Z.Y., Jiang, Z.Q., Xu, Y., Liu, Y., Zhang, H.R. (2020), Monthly runoff time series prediction by variational mode decomposition and support vector machine based on quantum-behaved particle swarm optimization. *Journal of Hydrology*, 583, 1-12.
- Foba Kakeu, V.J., Boum, A.T., Mbey, C.F. (2021), Optimal reliability of a smart grid. *International Journal of Smart Grid*, 5(2), 74-82.
- Guefano, S., Tamba, J.G., Azong, E.W., Monkam, L. (2020), Forecast of electricity consumption in the residential sector by Grey and autoregressive models. *Energy*, 214, 1-14.
- Guefano, S., Tamba, J.G., Monkam, L. (2020), Forecast for the Cameroon residential electricity demand based on the multilinear regression model. *Energy Power Engineering*, 12(5), 182-190.
- Guerrero-Prado, J.S., Alfonso-Morales, W., Caicedo-Bravo, E., Zayas-Pérez, B., Espinosa-Reza, A. (2020), The power of big data and data analytics for AMI data: A case study. *Sensors*, 20, 1-27.
- Hafeez, G., Alimgeer, K.S., Wadud, Z., Shafiq, Z., Usman, M., Khan, A., Khan, I., Khan, F.A., Derhab, A. (2020), A novel accurate and fast converging deep learning-based model for electrical energy consumption forecasting in a smart grid. *Energies*, 13, 1-25.
- Hurst, W., Curbelo Montañez, C.A. (2019), Profiling with Smart Meter Data in a Virtual Reality Setting. *The 4th International Conference on Applications and Systems of Visual Paradigms*. p1-6.
- Jadidi, A., Menezes, R., Souza, N., Castro L.A.C. (2019), Short-term electric power demand forecasting using NSGA II-ANFIS model. *Energies*, 12, 1-8.
- Jiang, Z., Lin, R., Yang, F. (2018), A hybrid machine learning model for electricity consumer categorization using smart meter data. *Energies*, 11, 1-19.
- Kasule, A. (2020), Using PSO and Genetic algorithms to optimize ANFIS model for forecasting Uganda's net electricity consumption. *University Journal of Science*, 24(2), 324-337.
- Kavousi-Fard, A., Samel, A., Marzbani, F. (2014), A new hybrid modified firefly algorithm and support vector regression model for accurate short term load forecasting. *Expert Systems With Applications*, 41(13), 6047-6056.
- Kazemi, S.M., Seied Hoseini, M.M., Abbasian-Naghneh, S., Rahmati, S.H.A. (2014), An evolutionary-based adaptive neurofuzzy inference system for intelligent short-term load forecasting. *International Transactions in Operational Research*, 2, 311-326.
- Kouhi, S., Keynia, F. (2013), A new cascade NN based method to short-term load forecast in deregulated electricity market. *Energy Convers. Manage*, 71(1), 76-83.
- Kumaran, J., Ravi, G. (2015), Long-term sector-wise electrical energy forecasting using artificial neural network and biogeography-based optimization. *Electric Power Components and Systems*, 11, 1225-1235.
- Kyung, S.B., Young, S.B., Dug, H.H., Gilsoo, J. (2005), Short-term load forecasting for the holidays using fuzzy linear regression method. *IEEE Transactions on Power Systems*, 20(1), 96-101.
- Laouafi, A., Mordjaoui, M., Dib, D. (2015), One-hour ahead electric load forecasting using neuro-fuzzy system in a parallel approach. *Computational intelligence applications in modeling and control. Studies in Computational Intelligence*, 575, 95-121.
- Li, K., Xie, X., Xue, W., Dai, X., Chen, X., Yang, X. (2018), A hybrid teaching-learning artificial neural network for building electrical energy consumption prediction. *Energy and Buildings*, 174, 323-334.
- Mbey, C., Boum, A., Nneme, L.N. (2020), Roadmap for the transformation of the South Cameroon interconnected network (RIS) into smart-grid. *American Journal of Energy Engineering*, 8(1), 1-8.
- Mollaiy-Berneti, S. (2016), Optimal design of adaptive neuro-fuzzy inference system using genetic algorithm for electricity demand forecasting in Iranian industry. *Soft Computing*, 20(12), 4897-4906.
- Moon, J., Kim, Y., Son, M., Hwang, E. (2018), Hybrid short-term load forecasting scheme using random forest and multilayer perceptron. *Energies*, 11(12), 1-10.
- Mordjaoui, M., Haddad, S., Medoued, A., Laouafi, A. (2017), Electric load forecasting by using dynamic neural network. *International Journal of Hydrogen Energy*, 1-9.
- Nasr, G.E., Badr, E.A., Younes, M.R. (2002), Neural networks in forecasting electrical energy consumption: univariate and multivariate approaches. *International Journal of Energy Research*, 26, 67-78.
- Panapakidis, I.P., Dagoumas, A.S. (2017), Day-ahead natural gas demand forecasting based on the combination of wavelet transform and ANFIS/genetic algorithm/neural network model. *Energy*, 118, 231-245.
- Pousinho, H.M.I., Mendes, V.M.F., Catalão, J.P.S. (2011), A hybrid PSO ANFIS approach for short-term wind power prediction in Portugal. *Energy Conversion and Management*, 52(1), 397-402.
- Selakov, A., Cvijetinovi, D., Milovi, L., Mellon, S., Bekut, D. (2014), Hybrid PSO-SVM method for short-term load forecasting during periods with significant temperature variations in city of Burbank. *Applied Soft Computing*, 16, 80-86.
- Shaikh, F., Ji, Q., Shaikh, P. H., Mirjat, N.H., Uqaili, M.A. (2017), Forecasting China's natural gas demand based on optimised nonlinear grey models. *Energy*, 140, 941-951.
- Shu, F., Luonan, C. (2006), Short-term load forecasting based on an adaptive hybrid method. *IEEE Transactions on Power Systems*, 21(1), 392-401.
- Sutthichaimethee, P., Wahab, H.A. (2021), A Forecasting model in managing future scenarios to achieve the sustainable development goals of Thailand's environmental law: Enriching the path analysis-VARIMA-OVi model. *International Journal of Energy Economics and Policy*, 11(6), 398-411.
- Völker, B., Reinhardt, A., Faustine, A., Pereira, L. (2021), Watt's up at home? Smart meter data analytics from a consumer-centric perspective. *Energies*, 14, 1-9.
- Wang, J., Li, L., Niu, D., Tan, Z. (2012), An annual load forecasting model based on support vector regression with differential evolution algorithm. *Applied Energy*, 94, 65-70.
- Wang, Q. (2009), Grey Prediction Model and Multivariate Statistical Techniques Forecasting Electrical Energy Consumption in Wenzhou, China. *2nd International Symposium on Intelligent Information*

- Technology and Security Informatics. p167-170.
- Wang, Y., Chen, Q., Hong, T., Kang, C. (2018), Review of smart meter data analytics: Applications, methodologies, and challenges. *IEEE Transactions on Smart Grid*, 1, 1-24.
- Wang, Y., Wang, J., Zhao, G., Dong, Y. (2012), Application of residual modification approach in seasonal ARIMA for electricity demand forecasting: A case study of China. *Energy Policy*, 48(3), 284-294.
- Wei, N., Li, C., Peng, X., Zeng, F., Lu, X. (2019), Conventional models and artificial intelligence-based models for energy consumption forecasting: A review. *Journal of Petroleum Science and Engineering*, 181, 1-22.
- Xu, W., Gua, R., Liu, Y., Dai, Y. (2015), Forecasting energy consumption using a new GM-ARMA model based on HP filter: The case of Guangdong Province of China. *Economic Modelling*, 45, 127-135.
- Yang, Y., Chen, Y., Wang, Y., Li, C., Li, L. (2016), Modelling a combined method based on ANFIS and neural Network improved by DE algorithm: A case study for short-term electricity demand forecasting. *Applied Soft Computing*, 49, 663-675.
- Yang, Y., Fan, C.J., Xiong, H.L. (2021), A novel general-purpose hybrid model for time series Forecasting. *Applied Intelligence*, 1, 608.
- Yem Souhe, F., Boum, A.T., Mbey, C.F. (2021), Roadmap for smart metering deployment in Cameroon. *International Journal of Smart Grid*, 5(1), 37-44.
- Yip, S.C., Wong, K., Hewa, W.P., Gan, M.T., Phan, R.C.W., Tan, S.W. (2017), Detection of energy theft and defective smart meters in smart grids using linear regression. *Electrical Power and Energy Systems*, 91, 230-240.
- Yuan, C., Liu, S., Fang, Z. (2016), Comparison of China's primary energy consumption forecasting by using ARIMA (the autoregressive integrated moving average) model and GM(1,1) model. *Energy*, 100, 384-390.
- Zhang, Z., Hong, W.C., Li, J. (2020), Electric load forecasting by hybrid self-recurrent support vector regression model with variational mode decomposition and improved cuckoo search algorithm. In *IEEE Access*, 8, 14642-14658.
- Zhu, S., Wang, J., Zhao, W., Wang, J. (2011), A seasonal hybrid procedure for electricity demand forecasting in China. *Applied Energy*, 88, 3807-3815.
- Zougagha, N., Charkaoui, A., Echchatbi, A. (2021), Artificial intelligence hybrid models for improving forecasting accuracy. *Procedia Computer Science*, 184, 817-822.